
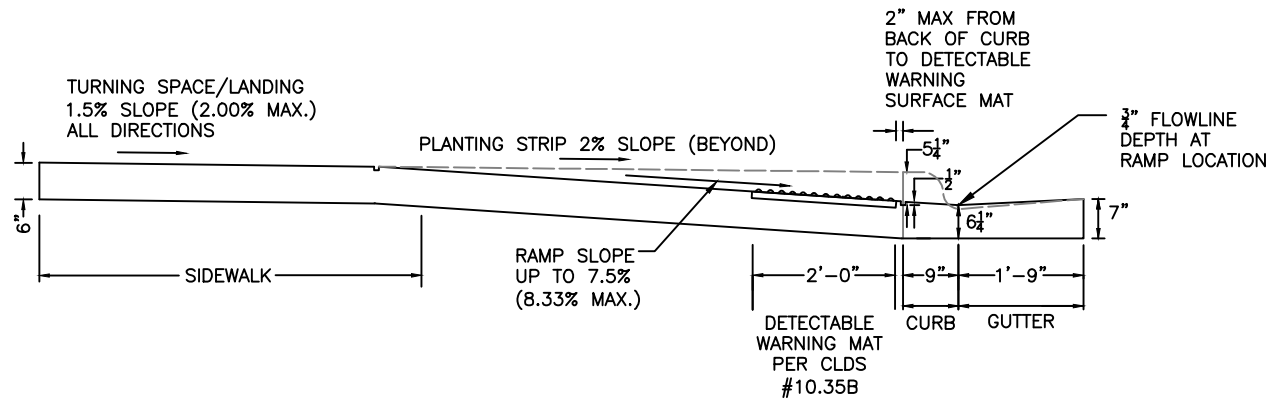


**NOTES:**

1. ENSURE FLUSH CONDITIONS AT CURB RAMP TO GUTTER TRANSITION.
2. TYPICALLY, THE SIDEWALK RUNNING SLOPE SHALL NOT EXCEED THE GENERAL GRADE ESTABLISHED FOR THE ADJACENT STREET.

SLOPE "A" 1.5% (2.00% MAX)
SLOPE "B" 7.5% (8.33% MAX)
SLOPE "C" 10% MAX

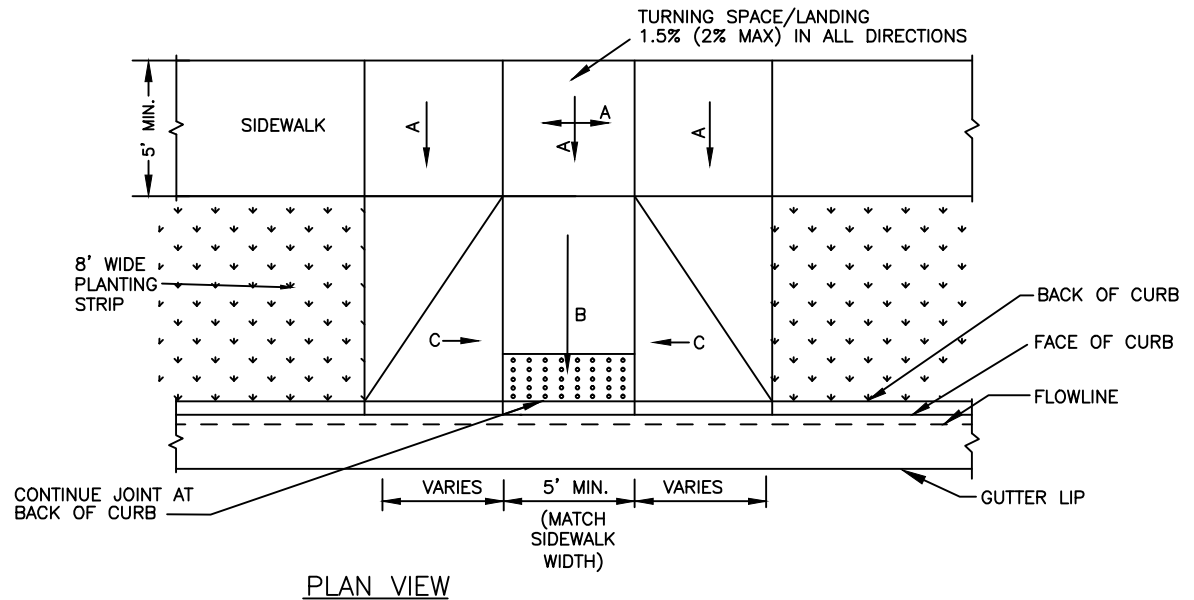

TYPICAL RAMP SECTION AT CENTERLINE

NOT TO SCALE



CITY OF CHARLOTTE  
LAND DEVELOPMENT STANDARDS  
INCLUDES CHARLOTTE ETJ

PERPENDICULAR CURB RAMP  
WITH 2'-6" CURB AND GUTTER

STD. NO.	REV.
10.31A	14